




Dimensions



Accessories

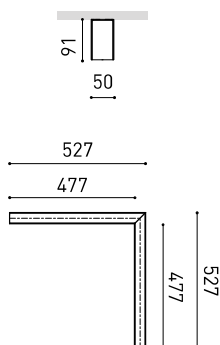

PRODUCT

| | |
|-----------|--|
| Name | FIFTY+ SURFACE CUSTOM CORNER DIM PUSH 4000K NT |
| Reference | A4430532NT |
| Color | Textured black |
| RAL | 9005 |
| Category | CUSTOM SYSTEMS |

LIGHT SOURCE

| | |
|-------------------------|-----------------|
| Type | LED |
| Gross luminous flux | 2400 lm |
| Colour temperature | 4000 K |
| Chromatic stability | MacAdam Step 2 |
| Colour Rendering Index | CRI>90 |
| Power | 15,4 W |
| Current | 700 mA |
| Efficacy | 151 lm/W |
| LED lifespan | L80B10 >60.000h |
| Energy efficiency class | D |

LIGHTING FIXTURE | PHOTOMETRIC DATA

| | |
|---------------------|----------------|
| Lighting efficiency | 70% / UGR 47% |
| Light beam angle | 104° / UGR 62° |

LIGHTING FIXTURE | ELECTRICAL DATA

| | |
|-----------------------------|-------------------------|
| Driver | Included - Fast Connect |
| Power values of the system | 18,22 W |
| Frequency | 50/60 Hz |
| Dimming | Push |
| Electrical insulation class | II |


OTHER DATA

| | |
|----------------------|---------------------------|
| Sealing | IP20 |
| Wireless control | Please Consult |
| Diffuser included | No |
| Weight | 2860 g |
| Packaged weight | 3780 g |
| Packaging dimensions | 704 x 629 x 100 mm |
| Units per package | 1 |
| Materials | Aluminium / Polycarbonate |




Fifty+ is the longitudinal lighting profile for Custom application. Fifty + adds functional light and visual support to highlight the lines, volumes and transitions defined in the architecture. Having an Opal diffuser which disperses the light and a UGR diffuser that reduces the glare angle. Both are installed as a single part along its entire length so as not to interrupt the light beam.

Polar diagram

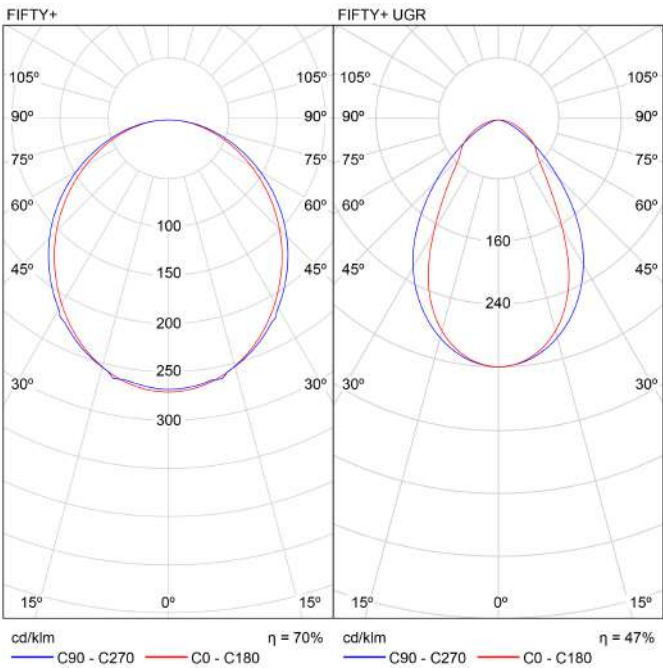

Conical diagram

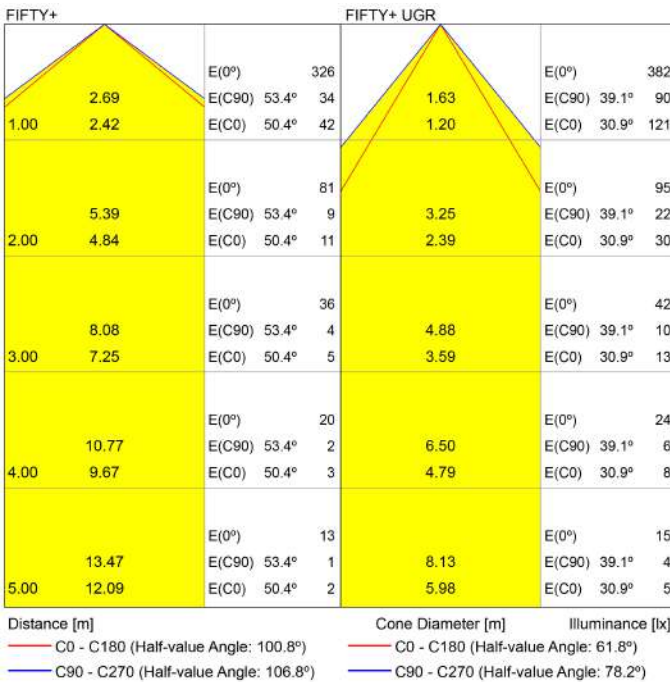

UGR

| Glare Evaluation According to UGR | | | | | | | | | | | | |
|--|----|--|------|------|------|------|---|------|------|------|------|------|
| Room Size | | 70 | 70 | 50 | 50 | 30 | 70 | 70 | 50 | 50 | 30 | 30 |
| p Ceiling | | 50 | 30 | 50 | 30 | 20 | 50 | 30 | 50 | 30 | 20 | 20 |
| p Walls | | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| p Floor | | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Room Size X Y | | Viewing direction at right angles to lamp axis | | | | | Viewing direction parallel to lamp axis | | | | | |
| 2H | 2H | 19.9 | 21.2 | 20.2 | 21.5 | 21.7 | 20.3 | 21.6 | 20.6 | 21.8 | 22.1 | 22.1 |
| | 3H | 21.6 | 22.8 | 21.9 | 23.0 | 23.3 | 22.0 | 23.2 | 22.4 | 23.5 | 23.7 | 23.7 |
| | 4H | 22.2 | 23.3 | 22.5 | 23.6 | 23.9 | 22.7 | 23.8 | 23.0 | 24.1 | 24.4 | 24.4 |
| | 6H | 22.6 | 23.7 | 23.0 | 24.0 | 24.3 | 23.2 | 24.2 | 23.5 | 24.5 | 24.8 | 24.8 |
| 4H | 2H | 22.8 | 23.7 | 23.1 | 24.1 | 24.4 | 23.3 | 24.3 | 23.7 | 24.6 | 24.9 | 24.9 |
| | 3H | 22.8 | 23.8 | 23.2 | 24.1 | 24.4 | 23.4 | 24.4 | 23.8 | 24.7 | 25.0 | 25.0 |
| | 4H | 20.5 | 21.6 | 20.8 | 21.9 | 22.2 | 20.9 | 21.9 | 21.1 | 22.2 | 22.5 | 22.5 |
| | 6H | 22.4 | 23.3 | 22.8 | 23.6 | 24.0 | 22.7 | 23.7 | 23.1 | 24.0 | 24.4 | 24.4 |
| 8H | 2H | 23.1 | 24.0 | 23.5 | 24.3 | 24.7 | 23.5 | 24.4 | 23.9 | 24.7 | 25.1 | 25.1 |
| | 3H | 23.7 | 24.4 | 24.1 | 24.8 | 25.2 | 24.1 | 24.9 | 24.6 | 25.3 | 25.7 | 25.7 |
| | 4H | 23.9 | 24.5 | 24.3 | 24.9 | 25.3 | 24.4 | 25.0 | 24.8 | 25.4 | 25.8 | 25.8 |
| | 6H | 24.0 | 24.6 | 24.4 | 25.0 | 25.4 | 24.5 | 25.1 | 25.0 | 25.5 | 26.0 | 26.0 |
| 12H | 2H | 23.4 | 24.1 | 23.9 | 24.5 | 24.9 | 23.8 | 24.5 | 24.2 | 24.9 | 25.3 | 25.3 |
| | 3H | 24.1 | 24.7 | 24.6 | 25.1 | 25.5 | 24.5 | 25.1 | 25.0 | 25.5 | 26.0 | 26.0 |
| | 4H | 24.4 | 24.9 | 24.9 | 25.3 | 25.8 | 24.8 | 25.3 | 25.3 | 25.8 | 26.2 | 26.2 |
| | 6H | 24.5 | 25.0 | 25.0 | 25.4 | 25.9 | 25.0 | 25.5 | 25.5 | 25.9 | 26.4 | 26.4 |
| Variation of the observer position for the luminance distances S | | | | | | | | | | | | |
| S = 1.0H | | +0.1 / -0.1 | | | | | +0.1 / -0.1 | | | | | |
| S = 1.5H | | +0.2 / -0.4 | | | | | +0.2 / -0.4 | | | | | |
| S = 2.0H | | +0.4 / -0.8 | | | | | +0.4 / -0.7 | | | | | |
| Standard table | | BK05 | | | | | BK06 | | | | | |
| Correction Summand | | 5.0 | | | | | 5.9 | | | | | |
| Corrected Glare Indices referring to 1200lm Total Luminous Flux | | | | | | | | | | | | |

UGR

| Glare Evaluation According to UGR | | | | | | | | | | | | |
|--|----|--|------|------|------|------|---|------|------|------|------|------|
| Room Size | | 70 | 70 | 50 | 50 | 30 | 70 | 70 | 50 | 50 | 30 | 30 |
| X | | 50 | 30 | 50 | 30 | 20 | 50 | 30 | 50 | 30 | 20 | 20 |
| Y | | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Room Size | | Viewing direction at right angles to lamp axis | | | | | Viewing direction parallel to lamp axis | | | | | |
| X | Y | | | | | | | | | | | |
| 2H | 2H | 15.5 | 16.5 | 15.7 | 16.7 | 16.9 | 14.9 | 15.9 | 15.2 | 16.1 | 16.4 | 16.4 |
| | 3H | 17.1 | 18.1 | 17.4 | 18.3 | 18.6 | 16.0 | 16.9 | 16.3 | 17.2 | 17.4 | 17.4 |
| | 4H | 17.7 | 18.6 | 18.0 | 18.9 | 19.1 | 16.3 | 17.2 | 16.7 | 17.5 | 17.8 | 17.8 |
| | 6H | 18.1 | 18.9 | 18.4 | 19.2 | 19.5 | 16.6 | 17.4 | 17.0 | 17.7 | 18.0 | 18.0 |
| 4H | 2H | 18.2 | 19.0 | 18.5 | 19.3 | 19.6 | 16.7 | 17.5 | 17.0 | 17.8 | 18.1 | 18.1 |
| | 3H | 18.3 | 19.0 | 18.6 | 19.3 | 19.7 | 16.7 | 17.5 | 17.1 | 17.8 | 18.1 | 18.1 |
| | 4H | 15.7 | 16.6 | 16.1 | 16.9 | 17.2 | 15.3 | 16.1 | 15.6 | 16.4 | 16.7 | 16.7 |
| | 6H | 17.6 | 18.4 | 18.0 | 18.7 | 19.0 | 16.6 | 17.3 | 16.9 | 17.6 | 18.0 | 18.0 |
| 8H | 2H | 18.3 | 19.0 | 18.7 | 19.3 | 19.7 | 17.1 | 17.7 | 17.5 | 18.1 | 18.4 | 18.4 |
| | 3H | 18.8 | 19.4 | 19.3 | 19.8 | 20.2 | 17.5 | 18.0 | 17.9 | 18.4 | 18.8 | 18.8 |
| | 4H | 19.0 | 19.5 | 19.4 | 19.9 | 20.3 | 17.6 | 18.1 | 18.0 | 18.5 | 18.9 | 18.9 |
| | 6H | 19.1 | 19.6 | 19.5 | 20.0 | 20.4 | 17.7 | 18.1 | 18.1 | 18.5 | 19.0 | 19.0 |
| 12H | 2H | 18.5 | 19.0 | 18.9 | 19.4 | 19.8 | 17.3 | 17.8 | 17.8 | 18.2 | 18.6 | 18.6 |
| | 3H | 19.1 | 19.5 | 19.5 | 19.9 | 20.4 | 17.8 | 18.2 | 18.3 | 18.7 | 19.1 | 19.1 |
| | 4H | 19.3 | 19.7 | 19.8 | 20.1 | 20.6 | 18.0 | 18.4 | 18.5 | 18.8 | 19.3 | 19.3 |
| | 6H | 19.5 | 19.8 | 19.9 | 20.2 | 20.7 | 18.1 | 18.4 | 18.6 | 18.9 | 19.4 | 19.4 |
| 12H | 4H | 18.5 | 18.9 | 18.9 | 19.3 | 19.7 | 17.4 | 17.8 | 17.8 | 18.2 | 18.6 | 18.6 |
| | 6H | 19.1 | 19.5 | 19.6 | 19.9 | 20.4 | 17.9 | 18.2 | 18.3 | 18.7 | 19.1 | 19.1 |
| | 8H | 19.3 | 19.6 | 19.8 | 20.1 | 20.6 | 18.1 | 18.4 | 18.6 | 18.9 | 19.3 | 19.3 |
| | 8H | 19.3 | 19.5 | 19.8 | 20.1 | 20.6 | 18.1 | 18.4 | 18.6 | 18.9 | 19.3 | 19.3 |
| Variation of the observer position for the luminance distances S | | | | | | | | | | | | |
| S = 1.0H | | +0.3 / -0.3 | | | | | +0.3 / -0.5 | | | | | |
| S = 1.5H | | +0.5 / -0.4 | | | | | +1.2 / -1.2 | | | | | |
| S = 2.0H | | +0.9 / -0.9 | | | | | +2.3 / -1.8 | | | | | |
| Standard table | | BK05 | | | | | BK03 | | | | | |
| Correction Summand | | -0.9 | | | | | -2.4 | | | | | |
| Corrected Glare Indices referring to 1200lm Total Luminous Flux | | | | | | | | | | | | |

MANDATORY FOR INSTALLATION

| FIFTY +Diffuser (x meter) | LOR |
|----------------------------|-----|
| A447-00-00 | 70% |

Max length 30 m.



| FIFTY +UGR Diffuser (x meter)* | LOR |
|---------------------------------|-----|
| A447-00-10 | 47% |

Max length 30 m.



| FIFTY +End Caps Kit |
|-----------------------|
| A447-00-20- WT NT |





| FIFTY +Straight Joiner |
|------------------------|
| A447-00-30 |



| FIFTY +Power Line |
|-------------------|
| A443-00-00 |



Connection diagram:

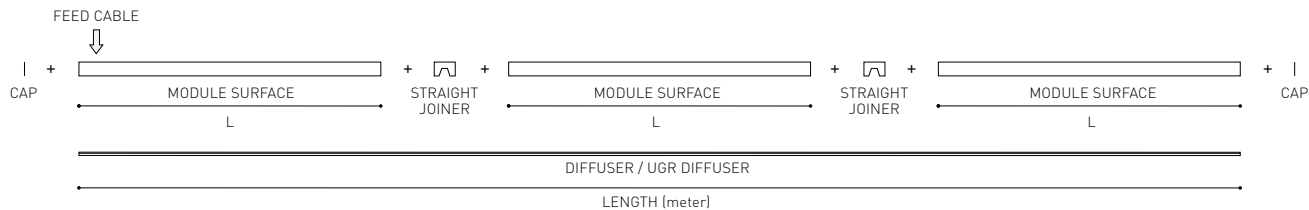


PRODUCT CONFIGURATOR

Use our online configurator to design your own custom product layout. The tool will guide you through the process and automatically calculate the required drivers and accessories.

[Start your configuration →](#)

COLOUR | WT ☐ | NT ☒ | MATERIAL | ☒ AL | ☐ PC |



Fuente de luz (LED) reemplazable por un profesional autorizado

Replaceable (LED only) light source by an authorized professional.

Source lumineuse (LED) remplaçable par un professionnel agréé

Sorgente luminosa (LED) sostituibile da parte di un professionista autorizzato

Austauschbare (LED) Lichtquelle durch einen autorisierten Fachmann



Equipo de control reemplazable por un profesional autorizado

Replaceable control gear by an authorized professional

Dispositif de commande remplaçable par un professionnel agréé

Alimentatore sostituibile da parte di un professionista autorizzato

Auswechselbares Betriebsgerät durch autorisierten Fachmann

Instrucciones para el final de vida y la eliminación de los componentes:

Instructions on end-of-life and component disposal:

Instructions pour la gestion des composants en fin de vie et leur mise au rebut :

Istruzioni per il fine vita e lo smaltimento dei componenti:


Anweisungen zur entsorgung der Leuchtenkomponenten:



Interrumpir la alimentación del aparato
Cut the power supply to the luminaire
Couper l'alimentation du luminaire
Interrompere l'alimentazione dell'apparecchio
Stromversorgung der Leuchte unterbrechen



Quitar la(s) fuente(s) de luz para el desecho
Remove light source(s) for disposal
Retirer la (les) source(s) lumineuse(s) pour l'élimination
Rimuovere la/le sorgente/e di luce per lo smaltimento
Lichtquelle(n) zur Entsorgung entfernen



Quitar la batería para el desecho
Remove the battery for decommissioning
Retirer la batterie pour sa mise au rebut
Rimuovere la batteria per la dismissione
Die Batterie ordnungsgemäß entsorgen



Quitar el equipo de control para el desecho
Remove control gear for disposal
Retirer le dispositif de commande pour l'élimination
Rimuovere l'alimentatore per lo smaltimento
Betriebsgerät zur Entsorgung ausbauen

Enviar los materiales a un centro de recogida RAEE
Send the materials to a WEEE collection centre
Envoyer les matériaux dans une déchetterie DEEE
Inviare i materiali ad un centro di raccolta RAEE
Die Materialien in einem WEEE-Zentrum entsorgen

